


R = RAMP AT 1:12 SLOPE MAX
 L = LANDING 1/8" PER FT. CROSS SLOPE
 MINIMUM SIDEWALK WIDTH AT
 LANDING = 4'-0"
 S/W = SIDEWALK AT 1:20 SLOPE MAX
 FOR 20' MAX LONGITUDINALLY

1. ⊕ DENOTES SPOT ELEVATION REQUIRED

TYPE "A" SIDEWALK AT BACK OF CURB

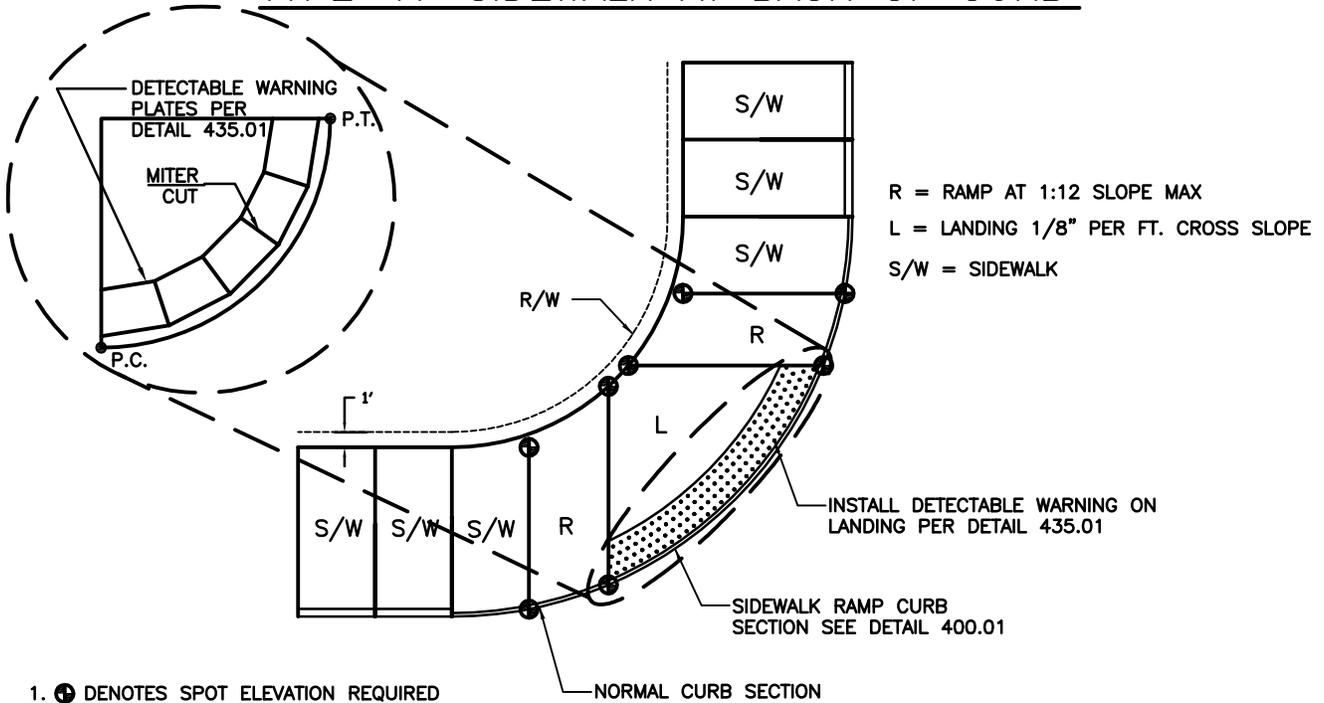

R = RAMP AT 1:12 SLOPE MAX
 L = LANDING 1/8" PER FT. CROSS SLOPE
 S/W = SIDEWALK

1. ⊕ DENOTES SPOT ELEVATION REQUIRED

2. DETECTABLE WARNING PLATES ARE TO BE
 MITERED EQUALLY ON BOTH SIDES TO BE FLUSH.

TYPE "B" SIDEWALK AT BACK OF CURB

NOTE:

1. LANDING CROSS SLOPE SHALL NOT EXCEED 2.00%.

<i>JLB</i>	1/1/12
Approved	Date
Revisions	



SIDEWALK RAMP PLAN VIEW
 Sidewalk at Back of Curb
 (Type A & B)

432.03