



MINIMUM SIDEWALK WIDTH
AT TOP OF RAMP = 4'-0"
1/8" PER FT. CROSS SLOPE

INSTALL DETECTABLE WARNING
ON RAMP PER DETAIL 435.01

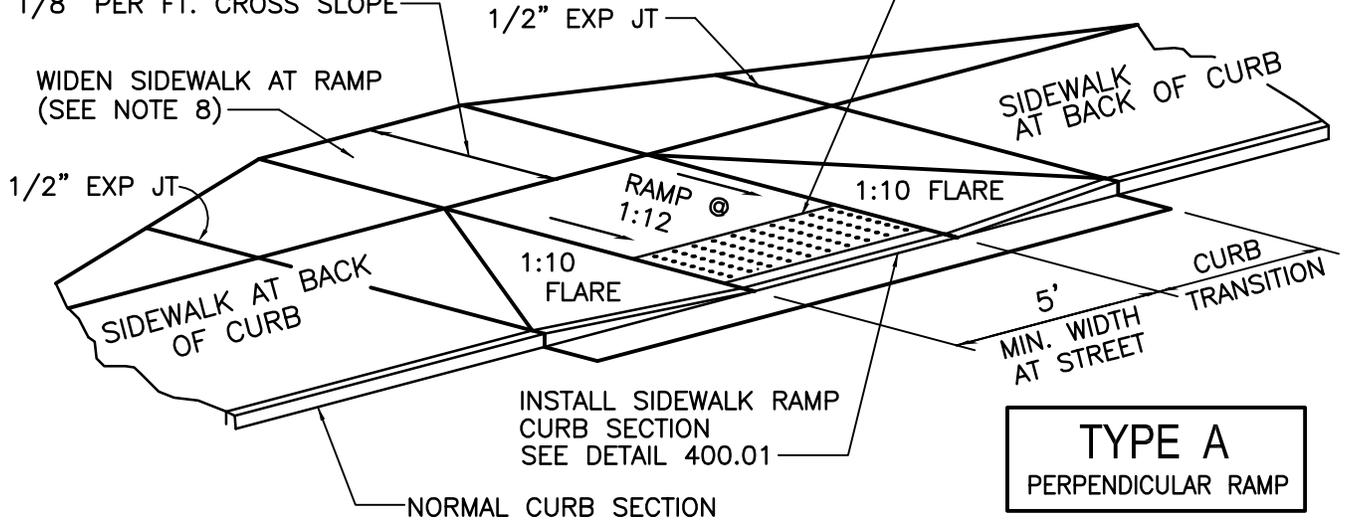

INSTALL DETECTABLE WARNING
ON LANDING PER DETAIL 435.01

1/2" EXPANSION JOINT
(Typical Both Sides)

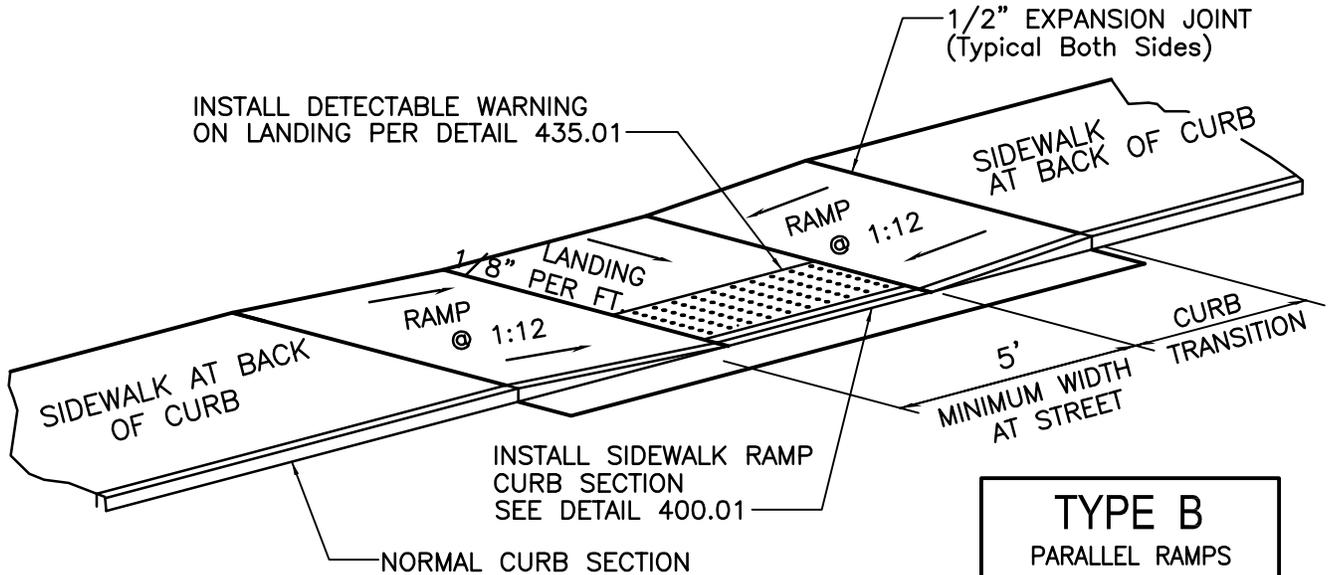

NOTE:

1. RAMP SHALL BE 4" THICK CLASS A CONCRETE REINFORCED SAME AS SIDEWALK.
2. EXPANSION JOINT SHALL BE 1/2" PREFORMED CORK OR BITUMINOUS EXPANSION JOINT MATERIAL.
3. MAXIMUM RAMP CROSS SLOPE IS 2.00%.
4. ALL SLOPES ARE MEASURED FROM THE HORIZONTAL.
5. REPLACE STANDARD CURB SECTION WITH SIDEWALK RAMP CURB SECTION - DETAIL 400.01
6. RAMP LENGTH IS DEPENDENT ON 1:12 MAX. SLOPE. USE FLATTER WHEN POSSIBLE.
7. LANDING AREA SHALL BE 4'-0" MIN WIDTH, CROSS SLOPE OF LANDING SHALL NOT EXCEED 2.00%.
8. TYPE "A" RAMP NOT APPLICABLE WHEN NORMAL SIDEWALK WIDTH DOES NOT PROVIDE 4'-0" LANDING AT THE TOP OF RAMP, WIDEN SIDEWALK OR USE TYPE "B" RAMP.
9. 1:10 FLARES ARE REQUIRED ON TYPE "A" RAMPS.

	<p>1/1/12 Date</p>
<p>Approved</p>	
<p>Revisions</p>	



MIDBLOCK SIDEWALK RAMP

Sidewalk at Back of Curb

433.01