



NOTES:

1. INSIDE DROP CONNECTION ONLY ALLOWED WITH PUBLIC WORKS DEPT. APPROVAL, WHEN PW DEPT. DEEMS UNFEASIBLE, UNPRACTICAL OR DANGEROUS TO PROVIDE OUTSIDE DROP.

2. DROP INLET PIPE TO BE SAME SIZE AND MATERIAL AS SEWER LINE.

3. ALIGNMENT OF TEE: DROP INLET PIPE MAY BE ADJUSTED TO A MAXIMUM OF 5% DEFLECTION.

4. ANNULAR SPACE AROUND NEW PIPE TO BE SEALED WITH NON-SHRINK GROUT, LINK SEAL, OR WATERTIGHT AND FLEXIBLE GASKET.

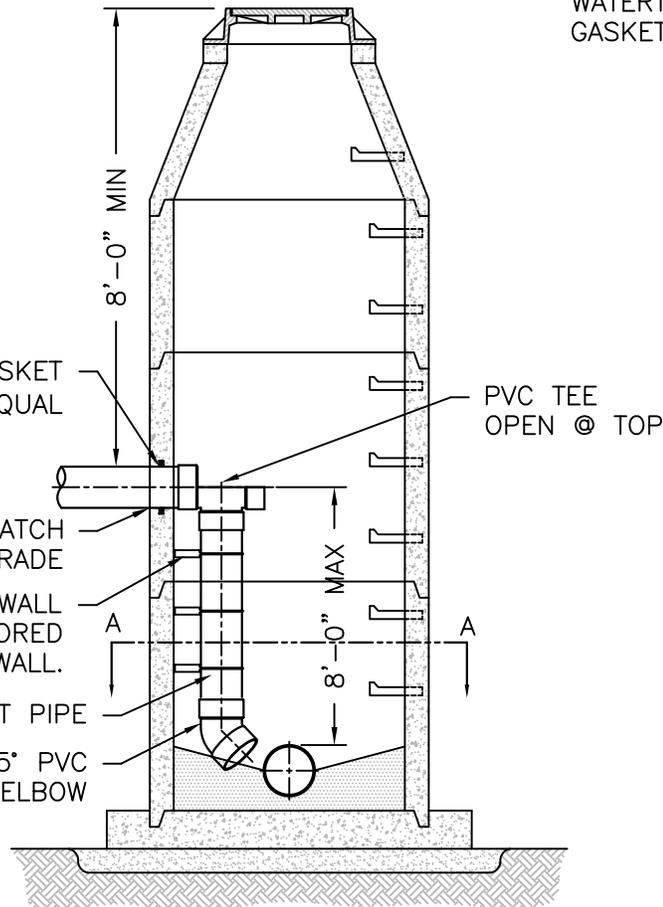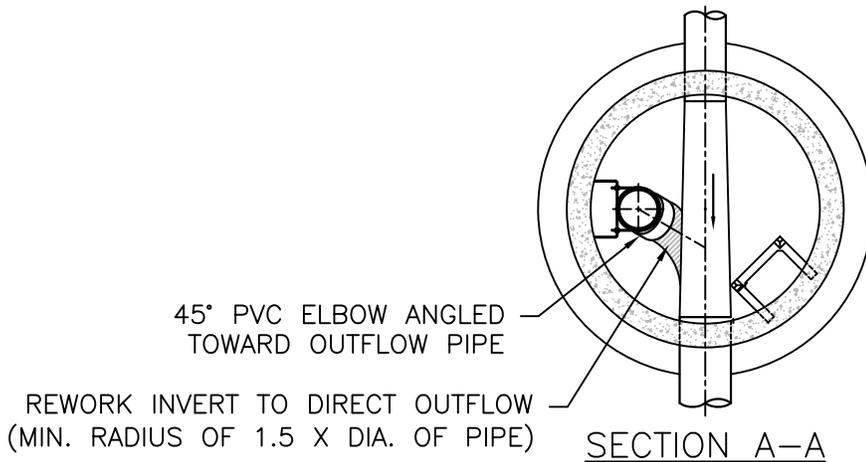

WATERTIGHT FLEXIBLE GASKET "A-LOK" OR EQUAL

PVC TEE OPEN @ TOP

COREDRIll AND MATCH EXISTING PIPE GRADE

SECURE PVC PIPE TO MH WALL WITH SS STRAPS ANCHORED TO MH WALL.

PVC DROP INLET PIPE

45° PVC ELBOW

8'-0" MIN

8'-0" MAX

8'-0"

A

A

*J.S.L.* 1/1/12  
Approved Date



# INSIDE DROP MANHOLE CONNECTION