


SECTION

MINIMUM BEARING AREA

PIPE SIZE	AREA SQ. FT.
6"	5
8"	8
12"	18
16"	33

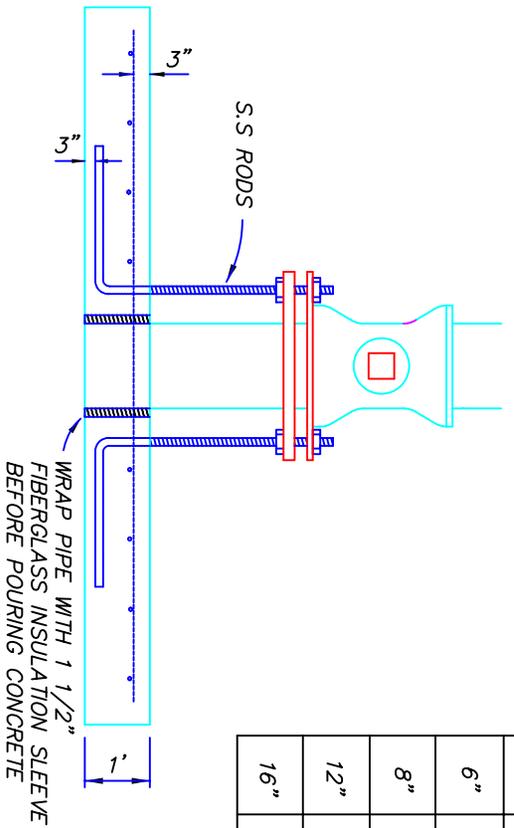

PLAN

THRUST COLLAR DETAIL  
NOT TO SCALE

CITY OF COLUMBIA WATER & LIGHT DEPARTMENT		SCALE N.T.S.	TITLE
		DRAWN	THRUST COLLAR DETAIL
		SHEET Q-6	
		REVISED 21 MAR 01	